

Public Review of Revised Standard

CCAH Reducing Radon in New Construction of One & Two Family Dwellings and Townhouses

COMMENT DEADLINE: August 26th, 2019

REQUESTED PROCESS AND FORM FOR FORMAL PUBLIC REVIEW COMMENTS

Submittals (MS Word preferred) may be attached by email to StandardsAssist@gmail.com or submitted in paper form by fax to (913) 780-2090

- 1) Do not submit marked-up or highlighted copies of the entire document.*
- 2) If a new provision is proposed, text of the proposed provision must be submitted in writing. If modification of a provision is proposed, the proposed text must be submitted utilizing the strikeout/underline format.*
- 3) For substantiating statements: Be brief. Provide abstract of lengthy substantiation. (If appropriate, full text may be enclosed for project committee reference.)*

REQUESTED FORMAT

Title of Public Review Draft: **CCAH 06-2019 Revision**

- **Name:** _____ **Affiliation:** _____
- **Clause or Subclause:** _____
- **Comment/Recommendation:** _____
- **Substantiating Statements:** _____
- ☐ Check here if your comment is supportive in nature and does not require substantive changes in the current proposal in order to resolve your comment.

Repeat the five bullet items above for each comment.

Requested registration of your contact information and copyright release.

**ONE TIME REGISTRATION
CONTACT INFORMATION AND COPYRIGHT RELEASE**

NOTE: AARST Consortium on National Radon Standards encourages original commentary on its standards. Commenters that choose to submit comments without an author's signature (due to difficulties in timeliness, proximity or other) shall be deemed to have done so at their sole discretion and have thereby acknowledged and accepted the copyright release herein. If commenters submit comments authored by others, those comments must also be accompanied by a signed copyright release from the author of the original comment. The original comment author and representing commenters may be asked to engage in dialog supporting their position.

Name:

Affiliation:

Address:

City:

State:

Zip:

Telephone:

Fax:

E-mail:

Copyright Release:

I hereby grant the AARST National Radon Standards Consortium the non-exclusive royalty rights, including non-exclusive royalty rights in copyright, in my proposals and I understand that I acquire no rights in publication of this standard in which my proposals in this or other similar analogous form is used. I hereby attest that I have the authority and am empowered to grant this copyright release.

Author's Signature: _____

Date _____

PLEASE FAX TO (913) 780-2090 or SHIP TO: StandardsAssist@gmail.com

Commenters are responsible for informing the standards assistant staff a when changing contact information or other preferences.

Notice regarding unresolved objections: While each committee seeks to resolve objections, please notify the committee responsible for an action or inaction if you desire to recirculate any unresolved objections to the committee for further consideration. Notice of right to appeal. (See Bylaws for the AARST Consortium on National Radon Standards - Operating Procedures for Appeals available at www.radonstandards.us, Standards Forum, Bylaws): (2.1) Persons or representatives who have materially affected interests and who have been or will be adversely affected by any substantive or procedural action or inaction by AARST Consortium on National Radon Standards committee(s), committee participant(s), or AARST have the right to appeal; (3.1) Appeals shall first be directed to the committee responsible for the action or inaction.

Contact information:

AARST Consortium on National Radon Standards.

Email: standards@aarst.org

Efax: 913-780-2090

Website: www.radonstandards.us

475 South Church Street - Suite 600, Hendersonville, NC 28792

CCAH 201x


Reducing Radon in New Construction of One & Two Family Dwellings and Townhouses

Introduction for reviewers

This proposed standard revision continues to prescribe building design and component features to install during construction and actions to verify occupant protection against radon hazards, to include fan activation if determined to be needed.

Document relationships

This standard compliments and is harmonized with the more limited scope of a newly proposed standard AARST RRNC *Rough-in of Radon Control Components in New Construction of 1 & 2 Family Dwellings and Townhouses*. The newly proposed RRNC standard is limited to construction activities only to address immediate needs of construction professionals and code authorities.

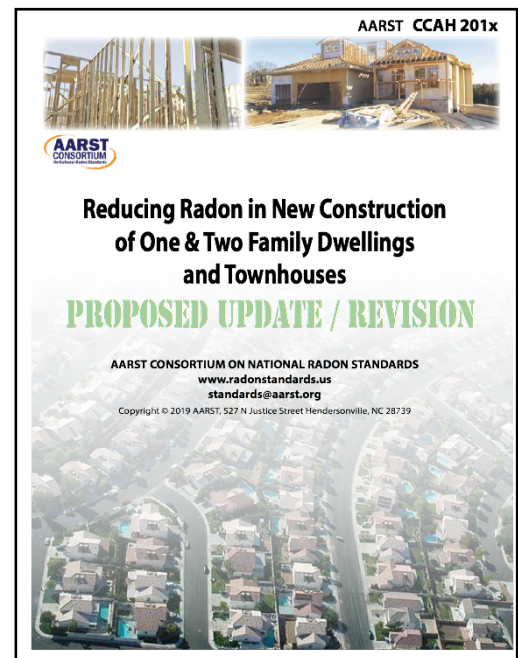

The Consensus Process

The consensus process developed for the AARST Consortium on National Radon Standards and as accredited to meet essential requirements for American National Standards by the American National Standards Institute (ANSI) has been applied throughout the process of promulgating this document. This standard is intended for publication under an established continuous maintenance program for regular publication of addenda or revisions, including procedures for timely consensus action on requests for change to any part of the standard.

AARST Consortium on National Radon Standards

Email: standards@aarst.org Website: www.RadonStandards.us

527 N Justice Street, Hendersonville, NC 28739

Notice of right to appeal: See Bylaws for the AARST Consortium on National Radon Standards available at www.RadonStandards.us. Section 2.1 of Operating Procedures for Appeals (Appendix B) states, “Persons or representatives who have materially affected interests and who have been or will be adversely affected by any substantive or procedural action or inaction by AARST Consortium on National Radon Standards committee(s), committee participant(s), or AARST have the right to appeal; (3.1) Appeals shall first be directed to the committee responsible for the action or inaction.”

Disclaimer: The AARST Consortium on National Radon Standards strives to provide accurate, complete and useful information. The AARST Consortium on National Radon Standards will make every effort to correct errors brought to its attention. However, neither the AARST Consortium on National Radon Standards, its sponsoring organization the American Association of Radon Scientists and Technologists nor any person contributing to the preparation of this document makes any warranty, express or implied, with respect to the usefulness or effectiveness of any information, method or process disclosed in this material. Nor does AARST or the AARST Consortium on National Radon Standards assume any liability for the use of, or for damages arising from the use of, any information, method or process disclosed in this document. It is the sole responsibility of radon practitioners using this standard to stay current with changes to the standard and to comply with local, state and federal codes and laws relating to their practice.

CCAH 201x
Reducing Radon in New Construction of One & Two Family Dwellings and Townhouses

SECTION 101
GENERAL

101.1 Purpose.

The purposes of this standard shall be as follows:

- 1) To specify radon control methods and techniques for use in dwelling units to reduce indoor radon concentrations to below the National Action Level (NAL) of 4 pCi/L [148 Bq/m³].
- 2) To provide minimum requirements for the *rough-In* of *radon control system* components in newly constructed *dwelling* units and activation of the *radon control systems*, if required.
- 3) To provide a model set of requirements for adoption by states and local jurisdictions.
- 4) To provide a means for authorized personnel to inspect and evaluate *rough-In* components of *radon control systems* and activated *radon control systems* in new construction.

101.2 Scope.

This standard shall be applicable only to newly constructed one- and two-family dwellings and townhouses.

SECTION 102
LIMITATIONS

102.1 General.

The requirements of this standard shall have limitations as indicated in Sections 102.1.1 through 102.1.6.

102.1.1 Results not guaranteed.

The application of the requirements of this standard does not guarantee that the NAL or any other specific indoor radon concentration will be attained.

102.1.2 Alterations.

The application of the requirements of this standard does not guarantee that the NAL or any other specific indoor radon concentration will be maintained where modifications, alterations, structural changes or additions to a dwelling occur.

102.1.3 ASD control.

The specifications within this standard are limited to *rough-In* of *radon control system* components and activation of *radon control systems* based on the methodology of Active Soil Depressurization (ASD).

102.1.4 Soil-borne radon.

The requirements of this standard address only soil-borne radon. Radon from other sources such as water and building materials are not addressed.

102.1.5 Prior systems.

This standard shall not apply to radon control means that have been installed prior to the effective date of this standard.

102.1.6 Soil testing.

This standard does not require or provide guidance for soil testing or analyzing the radon potential of a building site prior to construction of the building.

SECTION 201
DEFINITIONS

201.1 Definitions.

Terms not defined herein shall have their ordinary meaning within the context of their use. Ordinary meaning shall be defined in "Webster's Eleventh New Collegiate Dictionary."

ACCESS (limited). Point of entry to fan location that allows service personnel to reach an *ASD fan* or intended fan location for the purpose of installing or replacing an *ASD fan*. Such access does not require walkways, service platforms, level working spaces, receptacle and lighting outlets or clear and unobstructed passageways with continuous solid flooring such as are typically required for appliances that require periodic maintenance, servicing and inspection.

ACTIVE SOIL DEPRESSURIZATION (ASD). A *radon control system* involving fan-powered soil depressurization, including but not limited to *sub-slab depressurization* and *sub-membrane depressurization*.

ASD FAN. A type of fan that is designed and rated by the manufacturer for continuous duty and for use in an *ASD system*.

BACKWATER VALVE. A mechanical device that will allow water to flow in one direction while preventing airflow in the opposite direction.

BECQUERELS PER CUBIC METER [Bq/m³]. A unit of measure for the amount of radioactivity in one cubic meter of air. CONVERSION: 1 Bq/m³ equals 0.027 *picoCuries per liter (pCi/L)*.

CUBIC FEET PER MINUTE (CFM). A measure of the flow rate of a fluid, such as air. CONVERSION: 1 cfm = 1.699 cubic meters / hour [m³/hr].

CERTIFIED. A designation applied to individuals or companies that meet qualification requirements or are authorized by the state or other jurisdiction to provide *radon* laboratory, measurement or mitigation services. Alternatively, a designation applied to *radon* laboratories, measurement and mitigation professionals that meet current national qualification requirements established by the National Radon Proficiency Program (NRPP) or the National Radon Safety Board (NRSB). Also see LICENSED.

COMBINATION FOUNDATIONS. Buildings constructed with more than one foundation type, such as, basement and crawlspace or basement and slab-on-grade.

CRAWL SPACE. A foundation type with an open area beneath the livable space of a *dwelling* that typically has either a concrete slab or earthen floor. The crawl space can have an open height of a few inches to several feet. The crawl space may or may not be ventilated to the outdoors.

CUBIC METERS PER HOUR [m³/hr]. A measure of the flow rate of a fluid, such as air. CONVERSION: 1 cubic meter / hour = 0.589 *cfm*.

DEPRESSURIZATION. A negative pressure induced in one area with respect to another.

DIAGNOSTIC TESTS. Procedures, including communication tests and other tests, used to identify or characterize conditions under, beside and within buildings that could contribute to *radon* entry or elevated *radon* concentrations or that could provide information regarding the performance of a *radon control system*.

DWELLING. Any building that contains one or two units that are intended to be occupied for living purposes.

GEOTEXTILE MATTING. A product suitable for soil contact, that provides a void space laterally through the material to allow air movement. The void space is created through a matrix of woven mesh, “egg crate” support of a fabric enclosure or similar means.

GRAVEL. A mixture of crushed rock or naturally occurring pebbles. Commercially, it is classified according to the size of the particles.

INCHES OF WATER COLUMN (in. WC). A measure of pressure. CONVERSION: 1 *in. WC* = 249 *Pascals*.

KARST. An area underlain by limestone in which erosion has produced fissures, sinkholes, underground streams, or caverns.

LICENSED. A designation applied to individuals and/or companies that are qualified and specifically authorized as *radon* laboratories, measurement and/or mitigation professionals within certain states or jurisdictions that regulate *radon* services. Also see CERTIFIED.

MIL. - 1mil=1/1000 of an inch = 0.0254 millimeters.

NATIONAL ACTION LEVEL (NAL). The indoor *radon* concentration at which mitigation is recommended. The NAL is defined as the US Environmental Protection Agency's Action Level of 4 pCi/L [148 Bq/m³].

OUTDOOR AMBIENT RADON LEVELS. The amount of *radon* naturally occurring in outdoor air at a locality. The annual US national average outdoor *radon* level is 0.4 pCi/L [15 Bq/m³] but local conditions will vary.

OUTLET. A point on the wiring system at which current is taken to supply utilization equipment.

PASCAL [Pa]. A measure of pressure. CONVERSION: 1 Pa = 0.004 Inches of Water (in. WC).

PICOCURIES PER LITER (pCi/L). A unit of measure for the amount of radioactivity in a liter of air. CONVERSION: 1 pCi/L equals 37 Becquerels per Cubic Meter.

PIPE LOOP. A continuous length of perforated pipe extending around the inside perimeter of the foundation.

RADON. A naturally occurring, chemically inert, radioactive element (Rn-222) which exists as a gas.

RADON CONTROL SYSTEM. A system designed to reduce *radon* concentrations in the indoor air of a building.

ROUGH-IN. The installation of all parts and materials of an ASD system that must be completed prior to the placement of concrete, closure of building cavities and installation of finish materials. Such parts and materials are gas permeable layers, *soil gas retarders*, plenums, membranes, piping, *suction points*, discharge point and wiring.

SOIL GAS. The gas mixture present in soil that could contain *radon*, water vapor and other gases.

SOIL GAS COLLECTION PLENUM. A constructed enclosure for collecting *radon* and other *soil gases* from under a foundation.

SOIL GAS COLLECTOR. A gas permeable conduit constructed of *gravel*, perforated pipe or *geotextile matting* for collecting *radon* and other *soil gases* from within a *soil gas collection plenum* and connecting the plenum to the ASD pipe system.

SOIL GAS RETARDER. A continuous membrane or other comparable material laid over a *soil gas* plenum or earthen floor area that is used to retard the flow of *soil gases* into a building.

SUB-MEMBRANE DEPRESSURIZATION. A *radon* mitigation technique designed to maintain lower air pressure in the space under a *soil gas retarder* membrane than above it by use of an ASD fan drawing air from beneath the membrane.

SUB-SLAB DEPRESSURIZATION. A *radon* mitigation technique designed to maintain lower air pressure under a floor slab than above it by use of an ASD fan installed in the *radon* system piping that draws air from below the floor slab.

SUCTION POINT. Location where the *soil gas collector* is connected to the rough-in or ASD system piping.

TOWNHOUSE. A single family *dwelling* unit constructed in a group of three or more attached units where each unit extends from the foundation to the roof and has a yard or public way on at least two sides.

SECTION 301 RADON CONTROL ROUGH-IN COMPONENTS

301.1 Requirement.

Radon control rough-in components shall be installed in *dwelling*s in accordance with Section 302.

Exceptions:

- 1) Buildings supported entirely on foundation systems, such as piers, that do not have enclosed areas between the earth and the building floor system.
- 2) Where prior to occupancy, radon testing is conducted in accordance with ANSI-AARST MAH *Protocol for Conducting Measurements of Radon and Radon Decay Products in Homes* and demonstrates results that are below the National Action Level. Where required by the code official, testing shall be provided by an approved third party.

SECTION 302 ROUGH-IN COMPONENT INSTALLATION

302.1 Mitigation System Rough-In required.


The installation of *radon control rough-in* components shall be required for all foundations and *combination foundation* types, including *crawl space*, basement and slab-on-grade. The installation shall be in accordance with Sections 302.3 through 701.5. Figure 302.1 illustrates the installations in these various foundations.

Exception:

The installation of *radon control rough-in* components is **not** required for:

1. garage slabs where there is no living space above the garage.
2. portions of buildings supported on foundation systems, such as piers, that do not have any enclosed areas between the earth and the building floor system.

FIGURE 302.1
ROUGH-IN INSTALLATION IN VARIOUS FOUNDATIONS.

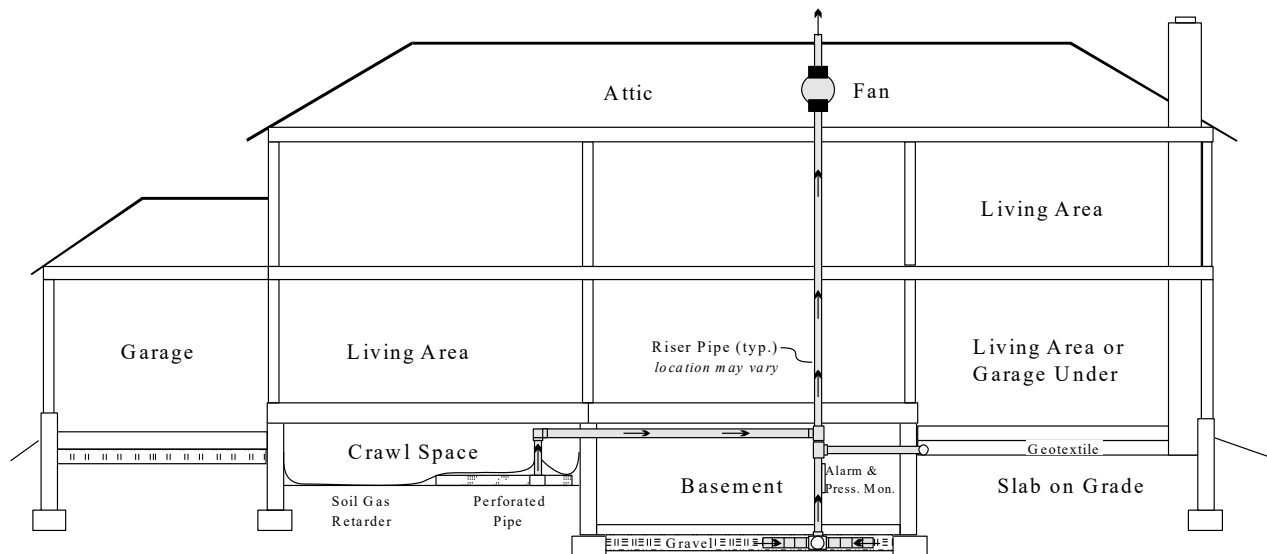

302.2 Foundation area.

As addressed in this standard, the foundation area shall be calculated from the inside perimeter dimensions of the foundation walls.

302.3 System Coverage Area

Additional *radon control system rough-Ins*, with an independent *exhaust* pipe extending from the *soil gas collection plenum* to the roof shall be installed where the total foundation area exceeds the Maximum Coverage Area shown in Table 302.3 and each multiple thereof or as specified by a *certified radon mitigation professional*.

TABLE 302.3

Exhaust Pipe Nominal Size	Maximum Foundation Coverage Area per System
3 inch [7.6 cm]	2,500 square feet (232 m ²)
4 inch [10.2 cm]	4,500 square feet (418 m ²)

SECTION 401

SOIL GAS COLLECTION PLENUMS

401.1 Soil gas collection plenums.

Foundation areas shall be constructed so as to create sealed *soil gas collection plenums* in accordance with Sections 402.1 through 404.1.6. Any groundwater control systems inside foundation areas shall be installed at the same elevation or lower so as to drain groundwater without closing off airflow through the soil gas collection plenums

SECTION 402

SUB-MEMBRANE

SOIL GAS COLLECTION PLENUMS

402.1 Crawl spaces without concrete floors.

For each *suction point* in crawl spaces without concrete floors, a *soil gas collector* shall be installed in accordance with Sections 402.1.1 through 402.1.7 and Section 404.1.

402.1.1 Soil gas collector.

Not less than one *soil gas collector* for each *suction point* shall be installed in accordance with Section 402.1.1.1, 402.1.1.2, 402.1.1.3 or 402.1.1.4.

402.1.1.1 Pipe soil gas collector.

The *soil gas collector* shall consist of a perforated pipe of 4 inch [10 cm] nominal diameter minimum. The pipe shall be not less than 10 feet [3 m] in length. Such piping shall be placed in a trench backfilled with clean aggregate meeting the criteria of Section 403.1.1.1 such that the pipe is completely surrounded by not less than 4 inches [10 cm] of aggregate.

402.1.1.2 Geotextile soil gas collector.

The *soil gas collector* shall consist of a strip of geotextile drain matting not less than 10 feet [3 m] in length and having a cross sectional area of not less than 12 square inches [77 sq. cm]. The strip of matting shall be placed on top of the soil or in a trench.

402.1.1.3 Gravel soil gas collector.

The *soil gas collector* shall consist of a uniform layer of clean aggregate not less than 4 inches [10 cm] in depth placed over the soil. The aggregate shall have a void ratio of not less than 35 percent or shall be in accordance with Size Number 4, 5, 56, or 6 as classified by ASTM C33.

402.1.1.4 Foundation form/drain/vent soil gas collector.

The *soil gas collector* shall consist of a loop of interconnected lineals used to cast the foundation footing and left in place to provide ground water control and provide a separate channel above the ground water channel for soil gas ventilation. Said soil gas ventilation channel shall have a cross sectional area no less than 12 square inches [77 sq. cm].

402.1.2 Suction points.

One *suction point* shall be provided for each *soil gas collector*. *Suction points* shall be installed in accordance with Section 402.1.2.1, 402.1.2.2 or 402.1.2.3 as applicable for the type of plenum installed.

402.1.2.1 Suction point for pipe soil gas collector.

The *suction point* for a pipe *soil gas collector* shall consist of a pipe fitting or other device having not less than three openings with two openings oriented so as to create multiple horizontal intake openings. Perforated pipe shall be inserted into both of the horizontal openings of the pipe fitting or device. One opening of the fitting or device shall be oriented in a vertical “up” position. Alternatively, the sub-membrane area and the other foundation types shall be interconnected by a *pipe loop soil gas collector* that is constructed in accordance with Section 403.1.1.3 and served by one or more *suction points*.

402.1.2.2 Suction point for geotextile soil gas collector.

The *suction point* for a geotextile *soil gas collector* shall consist of a pipe fitting or other device having not less than three openings with two openings oriented so as to create multiple horizontal intake openings. The horizontal openings shall be connected to the matting in a manner to facilitate airflow from the collector. One opening of the fitting or device shall be oriented in a vertical “up” position.

402.1.2.3 Suction point for gravel soil gas collector.

The *suction point* for a gravel *soil gas collector* shall consist of a pipe fitting or other device having not less than three openings with two openings oriented so as to create multiple horizontal intake openings. The horizontal openings shall be provided with not less than 5 feet [1.5 m] of perforated pipe extending from each opening of the fitting or device into the *gravel* layer. Said perforated pipe shall provide a minimum of 1 sq. inch [645 sq. mm] of open perforation area per lineal foot of pipe.

402.1.2.4 Suction points not permitted.

Suction points are not permitted through sump lids.

402.1.3 Fasten suction points.

Suction point fittings and devices shall be fixed in place to prevent dislocation.

402.1.4 Seal top of the soil gas collection plenum.

A *soil gas retarder* shall cover the top of the *soil gas collection plenum* and all exposed soil. The installation of the *soil gas retarder* shall be in accordance with Sections 402.1.4.1 through 402.1.4.4.

402.1.4.1 Sheeting.

The *soil gas retarder* membrane shall meet ASTM E1745 Class A, B or C.

402.1.4.2 Seams.

The seams between adjacent membrane sheets shall be overlapped not less than 6 inches [15 cm] and shall be sealed by one of the following methods:

1. A tape recommended by the membrane manufacturer.
2. Caulk complying with ASTM C920 class 25 or greater.

402.1.4.3 Repairs.

Tears or punctures in the membrane shall be sealed by one or more of the following methods:

1. A tape recommended by the membrane manufacturer.
2. An additional sheet of the membrane material that covers and overlaps the tear or puncture not less than 6 inches [15 cm] on all sides and that is sealed with a caulk complying with ASTM C920 class 25 or greater.

402.1.4.4 Penetrations.

Openings in the *soil gas retarder* membrane for piping, utilities, structural supports or similar penetrations shall be sealed.

402.1.5 Seal sides of the soil gas collection plenum.

The *soil gas retarder* membrane shall turn up onto foundation walls and shall be securely fastened and continuously sealed to the wall along the full perimeter with a caulk complying with ASTM C920 class 25 or higher.

402.1.6 Label required (membranes).

Soil gas retarder membranes shall be marked in a conspicuous place with a label to identify that the membrane is a component of a *radon* reduction system. The label lettering shall be of a height of not less than 1/4 inch [6.35 mm] and shall be of a color in contrast to the color of the background on which the lettering is applied.

SECTION 403 SUBSLAB SOIL GAS COLLECTION PLENUMS

403.1 Concrete floors.

The floors of basement, concrete crawlspace and slab-on-grade foundation systems shall be provided with a *soil gas collection plenum* installed in accordance with Sections 403.1.1 through 404.1.6.

403.1.1 Soil gas collector.

A *soil gas collector* shall be installed in accordance with Section 403.1.1.1, 403.1.1.2, 403.1.1.3 or 403.1.1.4.

403.1.1.1 Gravel.

A uniform layer of clean aggregate, not less than 4 inches [10 cm] in depth, shall be placed over the soil. The aggregate shall have a void ratio of not less than 35 percent or shall be Size Number 4, 5, 56, 57, or 6 as classified by ASTM C33.

403.1.1.2 Geotextile.

A layer of geotextile drainage matting shall be placed over a uniform layer of either soil or sand. The geotextile drainage matting shall be designed to allow the lateral flow of *soil gases* to the system's *suction point* fitting. The *geotextile matting* shall have a cross-sectional area of not less than 12 square inches [77 sq. cm] and shall be placed along the entire inside perimeter of the foundation at a distance of 12 inches [30 cm] to 18 inches [46 cm] from the foundation wall to the closest edge of the drainage matting. Deviation from the 12 inch [30 cm] to 18 inch [46 cm] distance to the foundation wall shall be allowed only at the location of obstacles such as plumbing and other utilities.

403.1.1.3 Pipe loop.

A loop of 4 inch [10 cm] minimum diameter perforated pipe shall be placed along the entire inside perimeter of the foundation at a distance of 12 inches [30 cm] to 18 inches [46 cm] from the centerline of the pipe to the foundation walls. Such piping shall be placed in a trench backfilled with clean aggregate meeting the criteria of Section 403.1.1.1 and surrounding the pipe for at least 1/3 of the outside pipe circumference. The cross-sectional area of the aggregate and pipe *soil gas collector* shall be at least 50 square inches [323 sq cm]. The piping shall form a continuous loop and pipe sections shall be joined with a connector device/method recommended by the manufacturer. Deviation from the 12 inch [30 cm] to 18 inch [46 cm] distance to the foundation wall shall be allowed to avoid obstacles such as plumbing and other utilities.

403.1.1.4 Foundation form/drain/vent soil gas collector.

The *soil gas collector* shall consist of a loop of interconnected lineals used to cast the foundation footing and left in place to provide ground water control and provide a separate channel above the ground water channel for soil gas ventilation. Said soil gas ventilation channel shall have a cross sectional area no less than 12 square inches [77 sq. cm].

403.2.2 Suction points.

Not less than one *suction point* shall be provided for each foundation type and not less than one *suction point* shall be provided for each *soil gas collector*. Alternatively, each *soil gas collector* shall be interconnected by a *pipe loop soil gas collector* that is constructed in accordance with Section 403.2.3 and served by one or more *suction points*. During construction, *suction point* openings above the slab shall be protected from the entry of aggregate, concrete and debris. *Suction points* shall be installed in accordance with Section 403.2.2.1, 403.2.2.2 or 403.2.2.3 as applicable for the type of *soil gas collector* installed.

403.2.2.1 Gravel layer soil gas collector.

A *suction point* for a *gravel* type *soil gas collector* shall consist of a pipe fitting or other device having not less than two openings oriented so as to create multiple horizontal intake openings within the *gravel* layer. The horizontal openings shall be provided with not less than 5 feet [1.5 m] of perforated pipe extending from each opening of the fitting or device into the *gravel* layer. Said perforated pipe shall provide a minimum of 1 sq. inch [645 sq. mm] of open perforation area per lineal foot of pipe.

403.2.2.2 Geotextile layer soil gas collector.

A *suction point* for a geotextile type *soil gas collector* shall consist of a pipe fitting or other device having not less than three openings with two oriented so as to create multiple horizontal intake openings connected to the geotextile mat in a manner to maintain airflow capacity from the plenum.

403.2.2.3 Pipe loop soil gas collector.

A *suction point* for a *pipe loop* type collector shall consist of a pipe tee fitting or pipe saddle device installed in the loop piping.

403.2.3 Multiple soil gas collection plenums.

Where interior footings divide a *soil gas collector* into two or more areas, each such area shall be provided with the required *suction points* and joined with *radon control system* piping in accordance with Section 501. Alternatively, each area shall be interconnected by a *soil gas collector* that is constructed in accordance with Section 403.1.1.2 or 403.1.1.3 and served by one or more *suction points*.

403.2.4 Suction points not permitted.

Suction points are not permitted through sump lids.

403.2.5 Fasten suction points.

Suction point fittings and piping shall be fastened in place to prevent dislocation during placement of the gas permeable layer, *soil gas retarder* and concrete.

403.2.6 Seal top of the soil gas plenum.

The *soil gas collector* and all exposed soil shall be covered with a *soil gas retarder* installed in accordance with Section 403.2.6.1.

403.2.6.1 Sheeting.

Polyethylene sheeting of not less than 6 *mils* [0.152 mm] in thickness or cross-laminated polyethylene sheeting of not less than 3 *mils* [0.076 mm] in thickness shall be installed on top of the *soil gas collector* and shall completely cover the area under the concrete floor and be sealed in accordance with Sections 403.2.6.1.1 through 404.1.6.

403.2.6.1.1 Seams.

Seams between adjacent polyethylene sheets shall be overlapped not less than 6 inches [15 cm] and sealed with a caulk complying with ASTM C920 class 25 or higher, or a tape installed in accordance with the manufacturer's recommendation.

403.2.6.1.2 Repairs.

Tears or punctures in the polyethylene sheeting shall be sealed or an additional sheet of polyethylene shall cover the tear or puncture with an overlap of not less than 6 inches [15 cm] on all sides. Such additional sheet shall be sealed and fixed in place with a caulk complying with ASTM C920 class 25 or higher or a tape installed in accordance with the manufacturer's recommendation to prevent displacement during slab casting.

403.2.6.1.3 Penetrations.

Openings in the *soil gas retarder* membrane for piping, utilities, structural posts and similar penetrations shall be sealed.

403.2.7 Penetrations.

Penetrations through the concrete slab and *soil gas retarder* shall be sealed with a caulk complying with ASTM C920 class 25 or higher or a method recommended by the membrane manufacturer.

403.2.8 Block-outs.

Where openings are cast or constructed in the concrete slab under plumbing fixtures, the openings shall be filled with expanding foam or a non-shrink grout. Exposed openings shall be sealed with non-shrink grout.

403.2.9 Seal sides of the soil gas collection plenum.

The intersection of floors and foundation walls shall be sealed with a caulk complying with ASTM C920 class 25 or higher. Sealing shall be performed in accordance with Section 403.2.9.1 or 403.2.9.2 or 403.2.9.3 or 403.2.9.4 or 403.2.9.5.

403.2.9.1 Seal floor to wall.

The intersection of floors and foundation walls shall be sealed.

403.2.9.2 Seal soil gas retarder to footing or wall.

Where foundation walls are solid concrete, the *soil gas retarder* shall extend from the footing up the wall not less than 4 inches [10 cm] and be sealed to the footing or to the foundation wall.

403.2.9.3 Seal soil gas retarder to wall.

Where foundation walls are masonry block the *soil gas retarder* shall extend from the footing up the wall not less than 4 inches [10 cm] and be sealed to the foundation wall.

403.2.9.4 Soil gas retarder in a monolithic slab.

Where the floors and footings are monolithic the soil gas retarder shall extend completely under the footing.

SECTION 404 SEALING SOIL GAS COLLECTION PLENUMS

404.1 General sealing of soil gas collection plenums.

Sealing of potential *soil gas* pathways shall be in accordance with Sections 404.1.1 through 404.1.6.

404.1.1 Sumps in floors.

Sumps in interior floors shall have a rigid lid and the lid shall be sealed with a gasket or a non-permanent caulking, such as silicone caulk and mechanically fastened in a manner to facilitate removal for maintenance. Pipe and wiring penetrations through the lid shall be sealed. The intersection of the floor and sump basin shall be sealed with a caulk complying with ASTM C920 class 25 or higher.

404.1.1.1 Label sump basins.

Sump basin covers shall be identified with a durable label that reads “Component of a Radon Reduction System. Do not tamper with or disconnect.” or equivalent wording. The lettering on the label shall be not less than 1/4 inch [6.35 mm] in height and shall be of a color in contrast to the color of the background on which the lettering is applied.

404.1.2 Hollow masonry unit walls.

The top course of hollow block masonry walls shall be made of solid masonry units or the top course shall be fully grouted. The top course under the full width of door and window openings shall be made of solid masonry units or the hollow masonry units shall be fully grouted. Where a brick veneer or other masonry ledge is installed, the course immediately below that ledge shall be made of solid masonry units or the top course shall be fully grouted. Other penetrations through foundation walls shall be sealed.

404.1.3 Floor drains.

Floor drains and condensate drains shall not allow *soil gas* entry.

404.1.4 Air ducts.

Air ducts located below concrete slabs shall be sealed to prevent *radon* entry and constructed in accordance with the International Residential Code (IRC).

404.1.5 Foundation drains.

Foundation drainage systems with openings to the atmosphere shall include a *backwater valve* or other means to isolate the *soil gas collection plenum* from any openings to atmosphere. Access shall be provided for maintenance.

404.1.6 Access openings.

Access openings in the floor provided for drain maintenance shall not allow *soil gas* entry.

SECTION 501

ROUGH-IN PIPING FOR RADON CONTROL SYSTEMS

501.1 Piping.

The *radon control system* piping that extends from the *soil gas* plenum to the point of discharge shall be rigid, non-perforated pipe in accordance with Sections 501.2 through 501.10.

501.2 Pipe size.

The *radon control system* piping shall be not less than 3 inch [7.6 cm] I.D.

501.3 ABS piping.

ABS pipe shall comply with ASTM D2661, F628 or F1488. The pipe wall thickness shall be Schedule 40.

501.4 PVC piping.

PVC pipe shall comply with ASTM D2665, F891, or F1488. The pipe wall thickness shall be Schedule 40.

Exception:

Rigid, non-perforated PVC pipe meeting above ground drainage and vent pipe specified in codes ¹ is an alternative to the material specified herein for use vertically within enclosed wall cavities.

501.5 Slope.

Above ground piping shall have a slope of not less than 1/8 inch [3.2 mm] per foot [30 cm]. Piping shall slope downwards towards the *suction point*. Piping arrangements that could allow water to collect are prohibited.

501.6 Joints.

Plastic pipe joints shall be solvent welded in accordance with Sections 501.6.1 and 501.6.2. Where disassembly of piping is required such as for removal of a fan, the joints shall be made with flexible couplings complying with ASTM D5926 or ASTM C1173.

501.6.1 ABS plastic pipe joints.

ABS plastic pipe joints shall be solvent welded in accordance with the pipe manufacturer's instructions with solvent cement conforming to ASTM D 2235.

501.6.2 PVC plastic pipe joints.

The joint surfaces for PVC plastic pipe and fittings to be solvent welded shall be prepared with a primer conforming to ASTM F 656. PVC plastic pipe joints shall be solvent welded in accordance with the pipe manufacturer's instructions with solvent cement conforming to ASTM D 2564.

501.7 Support.

Above ground piping shall be supported by the structure of the building using hangers or strapping designed for piping support. Supports for horizontal piping shall be installed at intervals not exceeding 4 feet [1.2 m] and supports for vertical piping shall be installed at intervals not exceeding 10 feet [3 m].

501.8 Protection against physical damage.

Where pipes penetrate top or bottom plates of stud walls and the nearest edge of the hole is within 1 ½ inches [3.8 cm] of the face of the member, the pipe shall be protected by steel shield plates. Such shield plates shall have a thickness of not less than 0.0575 inches [1.463 mm] (No. 16 gage). Such plates shall cover the face of the framing member(s) where the plate is bored, shall extend not less than 2 inches above bottom plates and not less than 2 inches below top plates and shall extend not less than 2 inches beyond each side of the pipe.

¹ ¹ As point of reference, see the International Residential Code (IRC) as published by the International Code Council.

501.9 Insulation required.

In interior spaces where *rough-in* piping is subject to freezing temperatures and in spaces where the external surface of the rough-in piping is subject to the formation of condensation, such piping shall be provided with insulation having an external vapor barrier and an R-value of not less than 1.8.

501.10 Labels required (piping).

Radon control system piping shall be marked prior to the closing of wall cavities with not less than two labels at each floor level with placement so as to provide visibility on either side of the wall cavity and at intervals not greater than 10 feet [3 m] along the developed length of the piping. The label shall identify that the item is a component of a *radon* reduction system. The label lettering shall be of a height of not less than 1/4 inch [6.35 mm] and shall be of a color in contrast to the color of the background on which the lettering is applied.

501.11 Labels required (System Rough-in).

Radon control system piping shall be marked with not less than one label in a conspicuous location. An additional label shall be placed on or within 12 inches [30 cm] of the electrical service panel. The labels shall state: **“TEST FOR RADON. The radon system has NOT been activated with a radon fan. Without testing, such system cannot be verified to reduce indoor radon to the levels recommended by the U.S. EPA.”** The label lettering shall be of a height of not less than 1/4 inch [6.35 mm] and shall be of a color in contrast to the color of the background on which the lettering is applied.

SECTION 601 RADON CONTROL SYSTEM TERMINATION

601.1 Outdoors.

The discharge point of *radon control system* piping shall be to the outdoors and shall be directed vertically upward. Where screens are installed on the terminus of radon exhaust pipes to prevent the entry of animals, such screens shall have a mesh size with a dimension of at least 0.5 inch (12.7mm)

601.2 Elevation and vertical walls.

The point of discharge of a *radon control system* piping shall comply with all of the following:

- 1) it shall be not less than 1 foot [30 cm] above the roof measured at the highest point of the penetration.
- 2) it shall be not less than 10 feet [3 m] above grade nearest the point of discharge.
- 3) it shall be not less than 10 feet [3 m] horizontally from a vertical wall that extends above the roof penetrated.

601.3 Windows and doors.

The discharge point of *radon control system* piping shall be not less than 10 feet [3 m] measured in any direction from, or not less than 2 feet vertically above, air intake openings including windows, doors and other gravity air intake openings and excluding attic ventilation openings. The specified clearances apply to the structure served by the *radon control system* and any adjacent structures.

601.4 Equipment air intake.

The discharge point of *radon control system* piping shall be not less than 3 feet [91 cm] above or 10 feet [3 m] away from mechanical air intake openings such as those for evaporative coolers, make-up air, and heat/energy recovery ventilators. The 10 foot [3 m] distance shall be measured around intervening obstacles.

SECTION 701 ACTIVE SOIL DEPRESSURIZATION (ASD) SYSTEM FAN

701.1 Provision for ASD fan.

A cylindrical space having a vertical height of not less than 36 inches [91cm] and a diameter of not less than 21 inches [53 cm] shall be provided in the area where the *ASD fan* will be installed if required. The space provided for the *ASD fan* shall be located according to Sections 701.4 & 701.5. The *ASD* pipe shall be centered in this space.

701.2 Electrical provided.

Branch circuit conductors shall supply an outlet located within 6 feet [1.8 m] of an *ASD fan* location.

701.2.1 Label.

The over-current device for the branch circuit supplying the *ASD fan* shall be labeled to indicate that it supplies the *radon* fan.

701.2.2 Disconnect.

Where the fan is not cord and plug connected, a means of electrical disconnect shall be provided for and within sight of the *ASD fan*. The electrical disconnect shall be labeled as to its purpose.

701.3 Fan access provided.

Limited *access* shall be provided for each *ASD fan* location to allow installation of *ASD fans* and replacement of same. *Access* entry shall be located not greater than 30 feet [9 m] from the *ASD fan* location.

701.4 Fan location.

The space provided for locating *ASD fans* shall be in attics, in garages that are not beneath conditioned spaces or outdoors. *ASD fans* shall not be installed below ground, in conditioned spaces, in occupiable spaces of a building or in any basement, crawlspace or other interior location that is directly beneath a conditioned or occupiable space of a building. *ASD fans* shall not be mounted in any location where pipe positively pressured by the fan is located inside conditioned or occupiable space.

701.5 Fan location for conditioned attics.

Where an *ASD fan* is located in an unvented attic space, the fan shall be isolated in an enclosure that does not communicate with the rest of the attic space. The fan enclosure shall be sealed against air leakage, shall be constructed to provide access to the fan and shall be provided with one or more ventilation openings to the outdoors that have a total net free area of not less than 25 square inches (161 cm²). The unconditioned fan enclosure shall meet the requirements of Sections 701.1 and 701.2. The construction of the enclosure shall meet the requirements of the applicable building and energy codes.

SECTION 801 RADON TESTING

801.1 Radon testing

A short-term radon test shall be initiated within 60 days of occupancy and shall be performed by a certified/licensed measurement professional. Testing shall be performed in accordance with AARST/ANSI MAH "Protocol for Conducting Measurements of Radon and Radon Decay Products in Homes" or applicable state protocols or requirements. Where testing results are greater than the NAL, a certified/licensed mitigator shall be required to perform diagnostic tests, mitigation action and radon testing shall be required until radon concentrations below the NAL are achieved.

801.2 Radon test kit required.

A minimum of one long term *radon*-in-air test kit from a *certified/licensed* laboratory shall be provided for the occupants of each *dwelling* unit.

SECTION 901
FAN ACTIVATION - ACTIVE SOIL DEPRESSURIZATION

901.1 Verify rough-in completion.

In association with activating an *ASD fan*, the *rough-in components* that are visually accessible shall be inspected for completion. Changes shall be made to correct any of the following requirements:

- 1) closed openings in concrete slabs and membranes over exposed soil to achieve a continuous air barrier that restricts air movement between soil gas and indoor air;
- 2) circuit conductors configured for continuous activation that terminate in a receptacle outlet located within 6 feet [1.8 m] of the potential ASD fan location;
- 3) potential fan location that is viable for fan installation with the fan and positively pressured system piping not located inside conditioned or occupiable space; and
- 4) system piping that extends from within the gas permeable layer(s) to above the roof and is sloped to drain water to the suction point(s).

Note—Exhibit 2 provides a sample form for “*Verification of Component Completion.*” Because many fans are installed after building construction, this form speaks to required components that can be verified prior to, but no later than during ASD fan installation.

901.2 Fan selection.

Fans installed in the *ASD* system shall be recommended by the manufacturer for *radon* mitigation. Such fans shall be designed and sealed by the manufacturer to minimize leakage of water and *soil gas* from the fan housing. The fan shall be sized and installed by a *certified/licensed radon mitigator*.

INFORMATIONAL TABLE 901.2
FAN SIZING^a

PIPE SIZE Nominal (I.D.)	TOTAL FOUNDATION AREA		
	Less Than 1600 sq. feet	1600 to 2500 sq. feet	2500 to 4500 sq. feet
	Less Than 149 sq. meters	149 to 232 sq. meters	232 sq. to 418 sq. meters
(3 inch) [7.6 cm]	Use Radon Fan Type: RF1 <u>RF1 Minimum rating:^b</u> 50 <i>cfm</i> @ 0.5 <i>in. WC</i> [85m ³ /hr @ 125 <i>Pa</i>]	Use Radon Fan Type: RF2 <u>RF2 Minimum rating:^b</u> 75 <i>cfm</i> @ 1.0 <i>in. WC</i> [127m ³ /hr @ 250 <i>Pa</i>]	N/A
(4 inch) [10 cm]	Use Radon Fan Type: RF1 <u>RF1 Minimum rating:^b</u> 50 <i>cfm</i> @ 0.5 <i>in. WC</i> [85m ³ /hr @ 125 <i>Pa</i>]	Use Radon Fan Type: RF1 <u>RF1 Minimum rating:^b</u> 50 <i>cfm</i> @ 0.5 <i>in. WC</i> [85m ³ /hr @ 125 <i>Pa</i>]	Use Radon Fan Type: RF2 <u>RF2 Minimum rating:^b</u> 75 <i>cfm</i> @ 1.0 <i>in. WC</i> [127m ³ /hr @ 250 <i>Pa</i>]

- a. Additional guidelines/references for sizing *ASD fans* and piping can be found in CCAH Companion Guidance.
- b. Radon Fan Types RF1 & RF2 minimum flow and pressure ratings are manufacturer specifications.

901.3 Fan location.

ASD fans shall be installed only outdoors, in attics or in garages that are not beneath conditioned spaces. *ASD fans* shall not be installed below ground, in conditioned spaces, in occupiable spaces of a building or in any basement, crawlspace or other interior location that is directly beneath a conditioned or occupiable space of a building. *ASD fans* shall not be mounted in any location where pipe positively pressured by the fan is located inside conditioned or occupiable space.

901.4 Orientation.

ASD inline fans shall be installed only on vertical *ASD* piping or as recommended by the manufacturer.

901.5 Installation.

ASD fans shall be installed in accordance with this standard and the manufacturer's instructions.

901.6 Flexible connectors required.

ASD fans shall be connected to the *ASD* piping using flexible unshielded couplings complying with ASTM D5926 or ASTM C1173. Connections shall be air and water-tight.

901.7 Fan start-up.

ASD fans shall be activated upon initial installation in the *ASD* system piping and shall run continuously.

SECTION 1001

SYSTEM MONITORING AND OCCUPANT INFORMATION

1001.1 System monitors required.

Each *ASD* system shall be provided with system monitors to monitor fan performance and notify occupants of fan failure. The system monitors shall be connected to the fan piping and located indoors in an area where the monitors are readily observable by the occupants. Each *ASD* system shall include both:

- 1) Negative pressure meter, such as manometer type pressure gauge.
- 2) *Fan failure notification by audible fan alarm or remote telemetry.*

1001.2 Electrical Power.

System monitors that require electricity for indication of fan failure shall be on non-switched circuits separate from the circuit powering the radon fan.

1001.3 Battery Power.

Battery operated monitors shall be equipped with a low battery-power warning feature.

1001.4 Automatic reset.

Electrical *ASD* system monitors, whether visual or audible, shall be designed to reset automatically when power is restored after power outage.

1001.5 Startup marking.

ASD system negative pressure monitors shall be clearly marked to indicate the pressure that existed when the system was initially activated. The monitor device shall have a durable label on or in close proximity to it that describes how to interpret the monitor and what to do if the monitor indicates that system performance has changed.

1001.6 System labels required.

System description labels made of durable material shall be placed on or within 12 inches [30 cm] of the electric service panel and also on the *ASD* system or other prominent location. The lettering on the label shall be not less

than 1/4 inch [6.35 mm] in height and shall be of a color in contrast to the color of the background on which the lettering is applied. The label shall state "**Radon Reduction System**," the installer's name, phone number, and applicable certification identification; date of installation; and an advisory stating that the building should be tested for *radon* at least every 2 years or as required or recommended by state or federal agencies. The label shall also include notice of additional *radon* resources available at www.epa.gov/radon and the *radon* hotline 1-800-SOS-RADON (767-7236) or information as required by the local state radon office.

1001.7 Documentation package.

The occupants of the *dwelling* shall be provided with a documentation package affixed to the ASD system pipe or other prominent location that includes the following:

- 1) A description of system operation, such as shown in Exhibit 1 "Understanding a Radon Reduction System".
- 2) *Radon* test data from before activation of the dwelling mitigation system, where available.
- 3) *Radon* test data after activation of the dwelling mitigation system.
- 4) The annual energy consumption of the installed *ASD fan(s)*, whether estimated or actual, and the projected monetary cost of such energy.
- 5) An advisory stating that the building should be tested for *radon* at least every 2 years or as required or recommended by state or federal agencies.

SECTION 1101

POST ACTIVATION EVALUATIONS

1101.1 Radon testing.

A *radon* test shall be performed after activation of rough-in systems with an *ASD fan* by a *certified radon measurement professional*. Testing shall be performed in accordance with AARST/ ANSI MAH "*Protocol for Conducting Measurements of Radon and Radon Decay Products in Homes*" or applicable state protocols or requirements.

1101.2 Functional evaluation.


In conjunction with activating an *active soil depressurization (ASD) system*, the negative pressure in the system's main riser piping shall be measured and recorded.

Exhibit 1 - Understanding a Radon Reduction System (Occupants)

The information contained in Exhibit 1 is a part of this American National Standard (ANS) and has been processed in accordance with ANSI's requirements for an ANS. Exhibit 1 contains information necessary for conformance to the standard.

General: *Radon* is a radioactive gas that has been found in homes all over the United States. It comes from uranium decay in soil, rock and water and gets into the air you breathe. The *radon* potential of any specific building lot is dependent on whether there is sufficient *radon* source material in the ground near your home's foundation. *Radon* typically moves through the ground to the air above and into your home through gaps and other pathways in the foundation. The primary health concern associated with *radon* is lung cancer. The Environmental Protection Agency (EPA) estimates that 21,000 people die in the US each year from *radon*-induced lung cancer due to exposure in the home.

Radon Reduction System: Your new home was constructed with an *Active Soil Depressurization (ASD)* System to protect your family's health. The *ASD* system is designed to limit *radon* entry into your home by keeping the soil under your home at a lower pressure than the air in your home. In doing so, *radon* and other *soil gases* below your home are exhausted above your roof through a specially designed fan. An *ASD* system is recognized by the EPA as the Best Available Technology for *radon* control because it keeps much of the *radon* from entering your home. The system is designed to run 24 hours a day, 7 days a week. The electrical power required to run the fan, which is the only active component in the system, will typically cost 5 to 25 cents per day depending upon the type of fan and your electrical utility rates. Cost to operate this fan would be less than operating a normal light bulb.

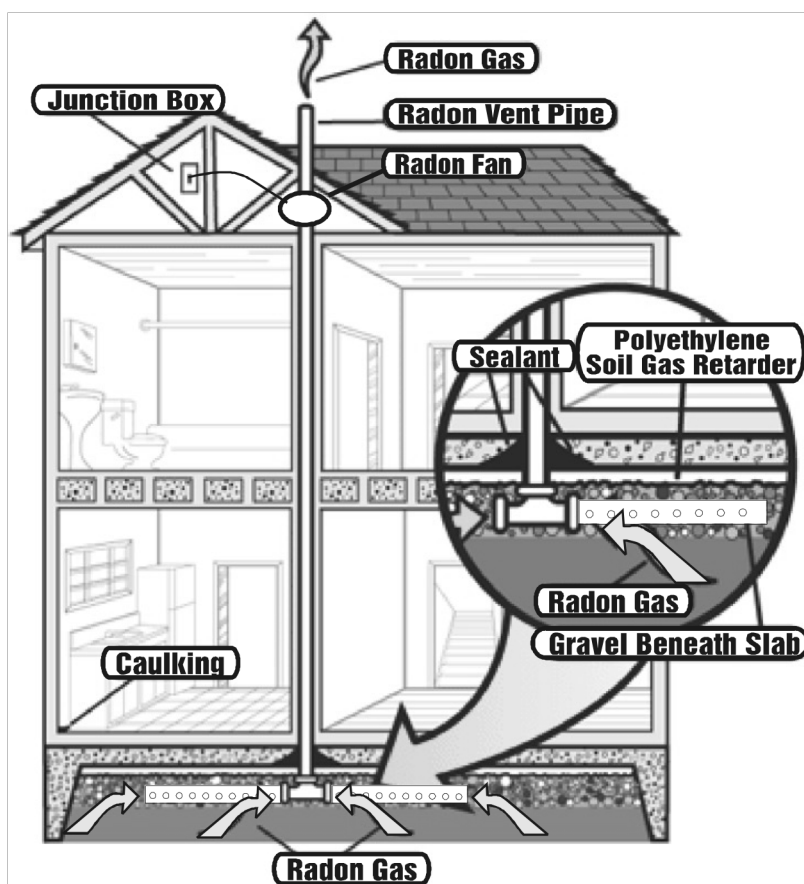

System Maintenance: Your *ASD* System is designed to provide many years of service under normal conditions without significant maintenance. As the occupant of this home, you need to routinely check the system pressure gauge or other system monitor to verify that the fan is operating correctly. There are various labeled components of your *radon* system such as pipe, crawlspace membrane, fan, system pressure monitor and sump basin. **DO NOT ALTER OR DISCONNECT** any of these components. If the sump basin is opened for required maintenance or repair, restore to the original condition immediately after completing work. You also need to be aware that foundation settling, renovations or

additions to your home can change your indoor *radon* concentrations. A *certified radon mitigation professional* can provide guidance when changes are to be made to the *dwelling* or provide a routine check-up on the operation of the system.


Understanding the System Pressure Gauge: The pressure gauge shown on the right is typical of a gauge used to monitor the pressure developed in the piping system by the *radon* fan. Your fan pressure should be checked regularly to ensure the fan system continues to operate properly. This gauge measures pressure in Inches Water Column (*in. WC*). This gauge does NOT measure *radon*.

Call for service if the measure changes substantially (20% or more) or if the gauge reads zero pressure (both columns equal).

Your *ASD* system also has a means to alert you of fan failure such as an audible alarm or other means.

Radon Testing: Be certain to complete a *radon* test after occupancy of your new home. The way you and your family live in your new home, how you set heating and cooling controls or use your clothes dryer and other exhaust fans can affect indoor *radon* levels. It is recommended that you conduct a long-term test—for 3 months or longer—to gain a better understanding of your *radon* exposure in the home. Be sure to complete your testing before the end of your new home warranty period.

Follow the instructions provided by the test laboratory to open, activate and place the test kit to test your *radon* levels.

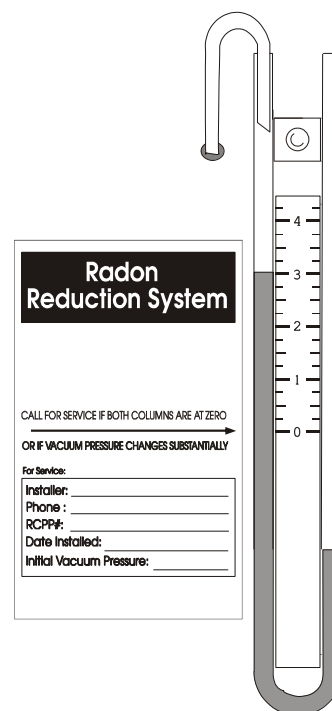

The USEPA recommends that you retest your home at least every 2 years or if major renovations or additions are made to the *dwelling*.

Other sources of radon: *Radon* can also be found in the water from private wells. Testing can determine if your well contains significant amounts of *radon*.

More Info: For more information on *radon*, *radon* testing or *radon* removal can be found at www.epa.gov/radon and the radon hotline 1-800-SOS-RADON (767-7236) or at your local state radon office.

NOTE: Exhibit 1 may be reprinted without license from AARST.

CCAH-RRNC 2018-2019 Consensus Body Committee

Sincere appreciation is both expressed and deserved for contributions of time and wisdom

Non-voting Chair: Dave Kapturowski

Non-voting Assist Team: Gary Hodgden

Stakeholder Group	Delegate	Affiliation
(Educators)	Bill Angell	Midwest Universities Radon Consortium
(Educators alternate)	Chad Robinson	Midwest Universities Radon Consortium
(Non-Regulated States)	Chrys Kelley	Colorado Dept. of Health and Environment
(Proficiency Program)	Bruce Snead	National Radon Proficiency Program (NRPP)
(Proficiency Program alternate)	Kyle Hoylman	National Radon Proficiency Program (NRPP)
(Federal EPA)	Jani Stoliarova	U.S. Environmental Protection Agency (EPA)
(Federal EPA alternate)	Nick Hurst	U.S. Environmental Protection Agency (EPA)
(Federal HUD)	John Schneider	U.S. Dept. of Housing and Urban Dev. (HUD)
(Public Health NGO)	Kevin Stewart	American Lung Association
(Home Inspectors)	Kurt Salomon	Home Inspection Professional (UT)
(Mitigation professionals)	Dan West	Professional Service Provider (OH)
(Mitigation alternate)	Tom Thies	Professional Service Provider (NM)
(Measurement professionals)	Matt Koch	Professional Service Provider (GA)
(Measurement alternate)	David Metzger	Professional Service Provider (OH)
(Code Officials)	Gregg Gress	International Code Council
(Home Builders NGO)	Dan Buuck	National Association of Home Builders
(Home Builders NGO alternate)	Gary Ehrlich	National Association of Home Builders
(Home Builders-Private)	Steve Tucker	Professional Service Provider (OR)
(Architects)	Ted Waldron	Professional Service Provider (VA)
(Architects alternate)	Tim Pitman	Professional Service Provider (SC)
(System Designer)	Keith Hoylman	Professional Service Provider (KY)
(Scientist)	David Wilson	Oakridge National Laboratory (DOE)

